



# Strobe Placement Guideline

Pleasant Prairie Fire & Rescue  
 8044-88<sup>th</sup> Avenue  
 Pleasant Prairie, WI 53158  
 firerescue@pleasantprairie.gov  
 262.694.8027  
 Web: pleasantprairiewi.gov

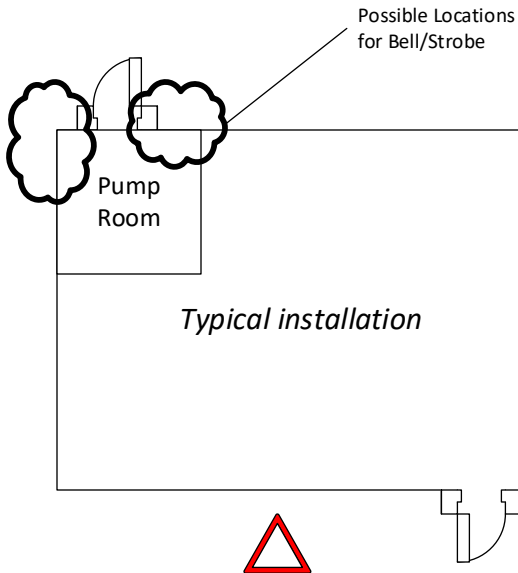


Exterior building Riser Strobe located at closet door and riser valve (If Interior or exterior)

SIDE VIEW

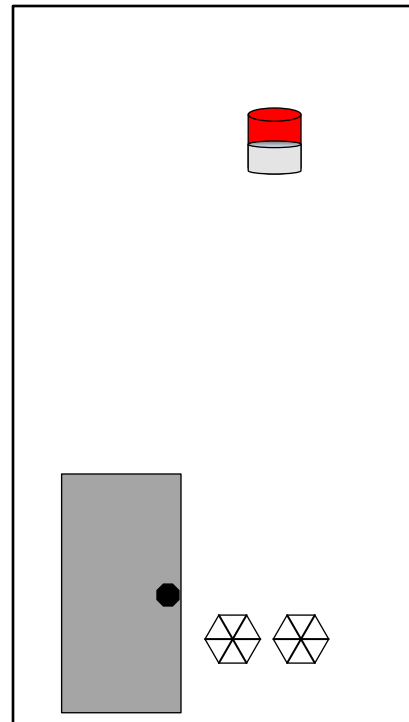

Waterflow & Pump Run Visual Detail

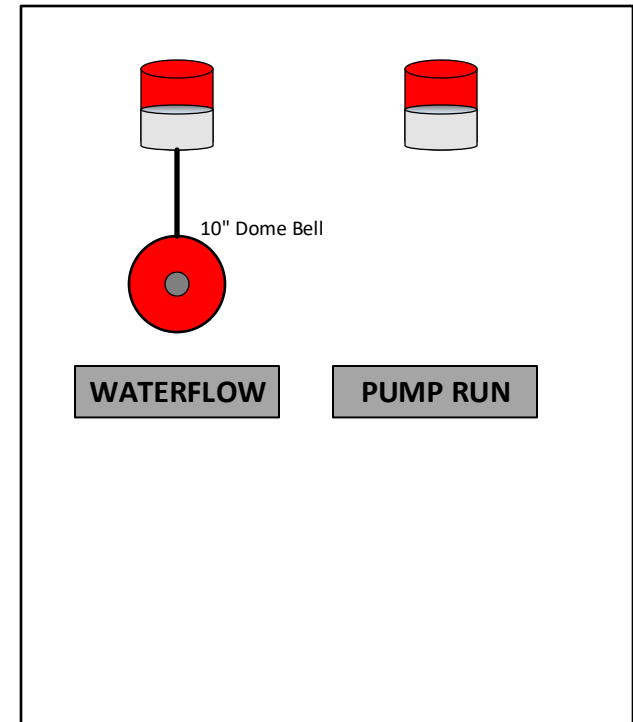

This guide is a supplement to the Fire dept. comments supplied for your project. Please review the specific comments as they relate to your project.

Locate near pump or riser room door.  
 Place so that devices can be seen from Pumper Pad



Strobe Light Options  
 Federal 131DST or 131ST  
 Whelen ISB120



Strobe Placement		SIZE	FSCM NO	DWG NO	REV
DRAWN	CRAIG ROEPKE			STROBE / BELL PLACEMENT GUIDELINE	B
ISSUED	1/16/2018	SCALE	Not to Scale	SHEET	1 OF 1

